


Excel 12

INTEGRATED ROOM CONTROL SOLUTIONS: FCU + LIGHT

PRODUCT DATA

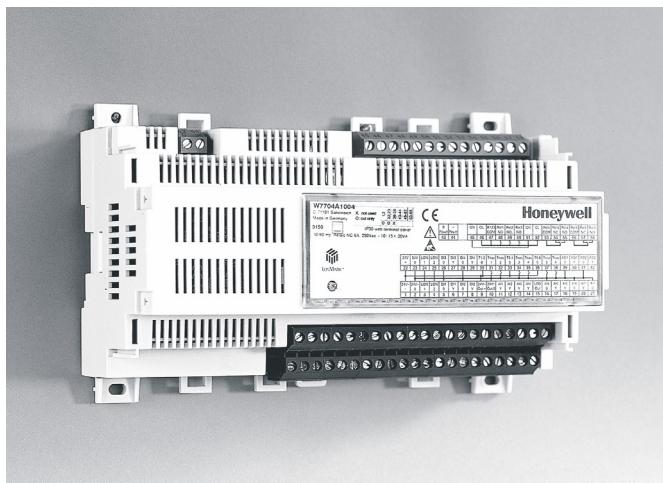

- 2-wire FTT-10A LONWORKS® bus interface
- LonMark® certified
- Easily-accessible service button and service LED
- Application can be configured to user-specific needs via LNS™-based plug-in
- Applications can be downloaded via LONWORKS into flash memory (thus increasing flexibility)

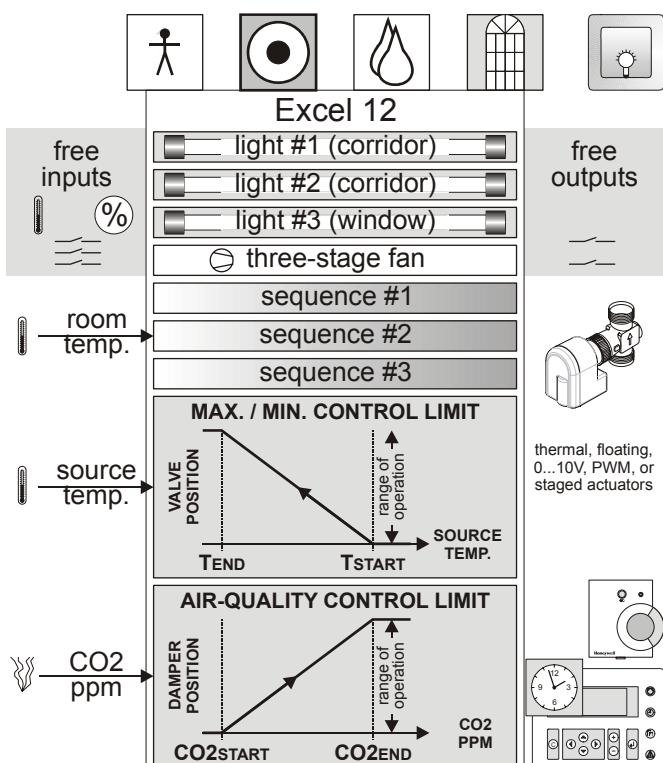


Fig. 1. Functional overview

FEATURES

- Two-in-one controller for HVAC and lighting reduces hardware costs and engineering effort (one LONWORKS® node instead of two)
- HVAC application supports three sequences (heat, cool or change-over) and min. / max. control limits and air-quality control
- Light application supports three lamps. Up to two of the three light loops can be constant light control loops. Light switching can be done depending on light level and occupancy (configurable via plug-in)
- Unused inputs can be utilized for monitoring via the LONWORKS network
- Unused digital outputs (relay or triacs) can be switched via LONWORKS
- Different kinds of HVAC actuators are supported (PWM, thermal, staged, floating, or analog actuators)
- Inputs / outputs can be freely assigned
- DIN rail (wiring cabinet / fuse box) mounting and wall-mounting supported
- Different power supply variants available
- Optional terminal protection covers for wall mounting
- Optional swivel label holders for wiring information

GENERAL

The Excel 12 FCU + Light application is LONMARK® certified, and can thus be used in all open LONWORKS® environments.

Excel 12 supports the following LONMARK® objects:

- one Node Object (LONMARK® object #0)
- one Space Comfort Controller Fan Coil Object (profile #8501)
- three Lamp Actuator Objects (profile #3040)
- one Occupancy Sensor Object (profile #1060)
- two Open Loop Actuator Objects (LONMARK® object #3)

A variety of hardware models with different power supplies are available. Page 7 provides a detailed overview of the available models.

Select the model fitting your particular needs.

The application can be downloaded into the Excel 12's FLASH memory.

Honeywell's LNS™ plug-in allows you to configure the application to match your specific requirements (e.g. configure the heating / cooling sequences, the light functionality and usage of otherwise unused inputs for monitoring according to your needs).

APPLICATION

The Excel 12 Fan Coil Unit (FCU) + Light application supports three HVAC sequences (HEAT, COOL, or CHANGEOVER) with control limits, air-quality control, free inputs, free outputs, and up to three lights.

The application is delivered together with the plug-in and must be downloaded into the Excel 12 controller's flash memory during start-up. The user can customize the application using Honeywell's LNS™ plug-in with CARE or any LNS™ tool (e.g. LonMaker for Windows™). Customizations can be saved / reloaded for easy configuration of multiple devices.

Application Overview

HVAC Application:

- Three sequences configurable for HEAT, COOL, and CHANGEOVER
- Support of thermal actuators, floating actuators, PWM, 0...10 Vdc, and staged output via triac outputs or relay outputs
- 3-stage fan via triac outputs or relay outputs
- Binary inputs for condensation, occupancy sensor, window contact, etc.
- Up to two limits (any combination of temperature limits and/or air-quality limits)
- Min./max. limits can be used to limit the sequence output according to your requirements. The limits are valid only in the occupancy mode.

The example below shows that a heating valve will be opened as soon as the source temperature drops below T_{Start} . T_{Start} , T_{End} and the range of operation can be configured using the plug-in.

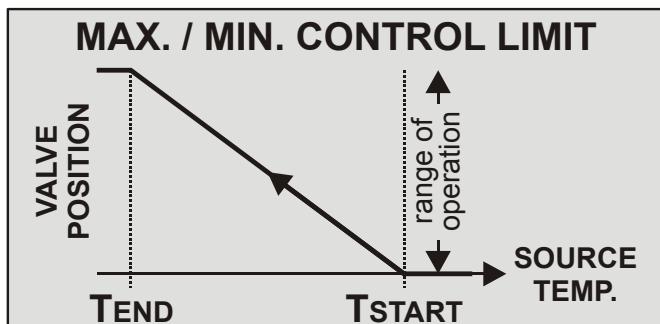


Fig. 2. Minimum Heating Example

NOTE: The min./max. limits have a higher priority than the normal control output.

- The air-quality can be controlled by opening a damper in dependence on the CO2 level. The CO2 ramp is defined by $CO2_{START}$, $CO2_{END}$, and the range of operation (entered using the plug-in).

Example:

- $CO2_{START}$ = 1000 ppm
- $CO2_{END}$ = 2000 ppm
- range of operation = 50%

The damper starts opening as soon as the level of 1000 ppm is reached. The maximum value (range of operation) is reached at position $CO2_{END}$.

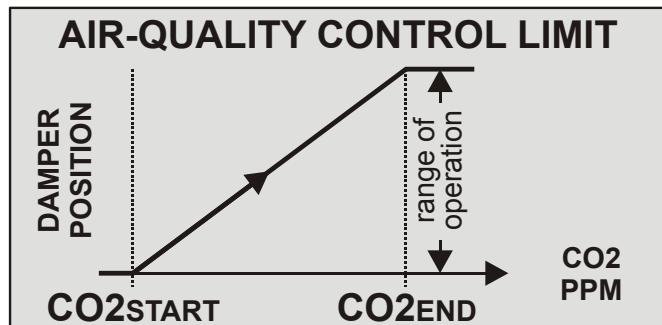


Fig. 3. Air-quality control (example)

Example:

- sequence 1: heating via radiator
- sequence 2: cooling via damper
- setpoint: 20 °C
- $CO2$ control for sequence 2
- $CO2_{START}$ = 1000 ppm
- $CO2_{END}$ = 1500 ppm
- range of operation = 50%

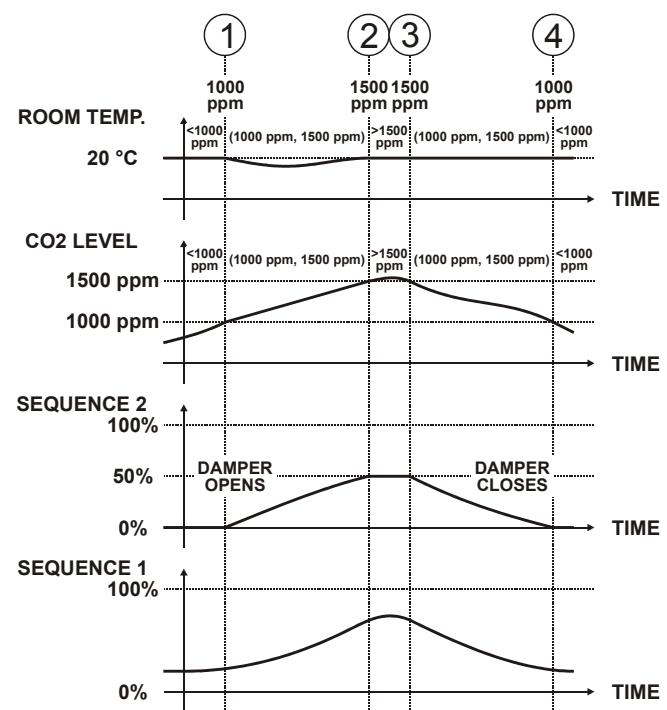


Fig. 4. Example

Before ①:

- CO2 level is OK → room temperature control, only
- Temperature at 20 °C

① CO2 level rises above CO2_{START}:

- CO2 level is too high, CO2 control starts with priority over the temperature control
- Damper opens, room temperature drops
- Temperature drops to below 20 °C → heating sequence starts heating

② CO₂ level rises above CO₂_{END}:

- Damper reaches max. range of operation
- Heating sequence achieves room temperature of 20 °C

③ CO₂ level drops below CO₂_{END}:

- Damper starts closing
- Room temperature is maintained at setpoint value

④ CO₂ level drops below CO₂_{START}:

- CO₂ level falls below CO₂_{START} → room temperature control, only
- Temperature is maintained at 20 °C

NOTE: The temperature limitation and the air-quality control have priority over the temperature control.

- Relative or absolute temperature setting via wall module.

Light Application:

- Three times ON / OFF switching dependent on:

- Occupancy
- Internal light level.

The light will be switched ON if the light level drops below the "dark level" and it will be switched OFF if it increases above the "bright level". The "dark level" and the "bright level" can be configured via the plug-in.

- Manual switching (via hardwired switches or LONWORKS® wall module)

- Two times dimming / constant light control for two lights with just one sensor.

Dimming / constant light control is performed via analog outputs (this requires an HFD [High-Frequency Device] for dimming with 1...10 Vdc input). An additional relay is required to switch the light ON/OFF.

Constant light control helps to save additional energy. Normally, fluorescent tubes lose about 15% of their illumination over their lifecycle. To compensate for this, rooms are therefore usually dimensioned with 15% more illumination than actually necessary. With constant light control, the light level needs to be only 85% in order to achieve the required brightness. Further savings and comfort can be achieved if there is a constant light level in the room and the light is automatically dimmed when more outside light enters. The Excel 12 supports window correction in order to reduce the light output of the window light. This functionality can be configured via the plug-in.

- Grouping of lights, e.g. switch three lights via a single pushbutton.

- Soft ON/OFF switching for dimmable lamps.

- Light sensor

The light intensities typically encountered in everyday life are listed in Table 1, while Table 2 presents the recommended light levels in various environments as set forth by DIN5035.

NOTE: One lux is equivalent to 0.0929 foot-candle.

Refer also to the plug-in help information for details.

Table 1. Typical light intensities

ambient conditions	intensity (lux)
summer day, cloudless	100,000
summer day, cloudy	20,000
winter day, cloudy	400
night, with full moon	0.3

Table 2. Recommended light intensities (DIN5035)

area	intensity (lux)
storage rooms	50...200
washrooms, cloakrooms, technical rooms, corridors	100
office rooms (near windows)	300
office rooms (minimal outside light)	500
open-plan office rooms	750
schools (daytime)	300
night schools	500
gymnasiums	200
show rooms	300
commercial kitchens	500

NOTE: The intensity level depends on the sensor type and the mounting location.

NOTE: The indoor light sensor must be suitable for sensing artificial light, and should be mounted more towards the corridor.

Free Inputs for Monitoring:

- Unused inputs can be used for monitoring. This application supports the following free inputs:
 - one temperature input (NTC20k)
 - one percentage input (0..10 V or 2..10 V)
 - three binary inputs
- The input values are communicated via nvoXL12Status.

Free Binary Outputs Can Be Switched Via LONWORKS:

- Up to two unused digital outputs (triac or relay outputs) may be switched via LONWORKS® (nviFreeOutput[0/1]).

Occupancy Modes:

- *Occupied mode:* The Excel 12 operates according to the "occupied" heating and cooling set-points.
- *Bypass:* After the bypass button of a hardwired wall module has been pressed or when corresponding data is received via the LONWORKS® network, the Excel 12 operates temporarily according to the "occupied" heating and cooling set-points. When the bypass time has elapsed, the controller reverts to scheduled mode. The bypass time can be configured via plug-in.
- *Standby mode:* The Excel 12 operates according to the "standby" heating and cooling set-points.
- *Unoccupied mode:* The Excel 12 operates according to the "unoccupied" heating and cooling set-points.

- **Occupancy sensor:** The occupancy sensor is used for the HVAC and light application. Hardwired and LONWORKS® occupancy sensors are supported. The occupancy sensor determines the effective occupancy mode during scheduled occupied periods (time program with occupancy schedule runs on a different controller connected to the LONWORKS® network). Depending upon the actual occupancy sensor state, the effective mode will be either "occupied" or "standby."

Wall Modules:

- LONWORKS® wall modules
- Hardwired wall modules (e.g. T7460, T7560)
- Wireless wall modules (e.g. W7070+T7270 or RT7070)

Master / Slave Functionality:

The master / slave functionality allows easy adaptation to changed room usage.

The sequences and the outputs of the slave controller must be configured in the same way as the master (e.g. sequence 1: heat, actuator type: thermal).

The temperature limit functionality and the air-quality functionality shall not be used in the slave controller if there is an EnergyHoldOff binding from the slave to the master.

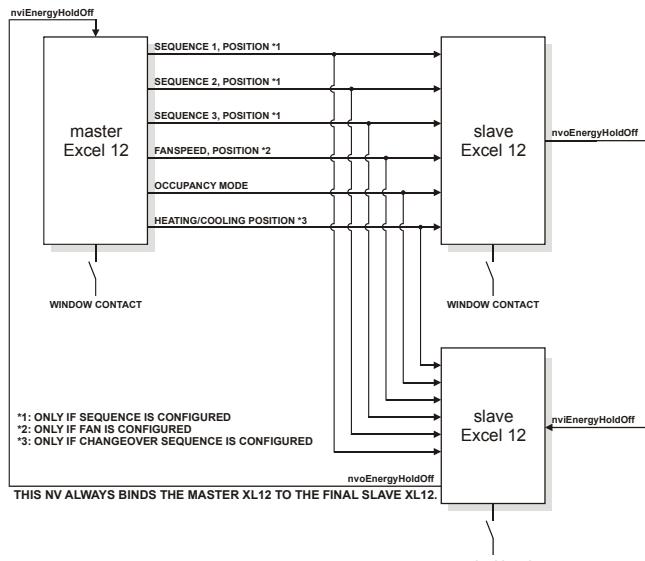


Fig. 5. Master/slave functionality and window contact

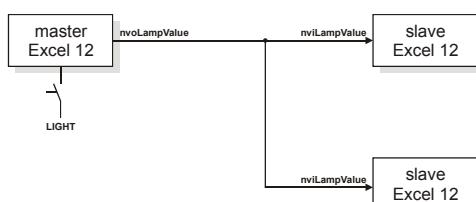


Fig. 6. All lights switched via master pushbutton

NOTE: Binding via LONWORKS results in a short delay between the switching of the different lamps.

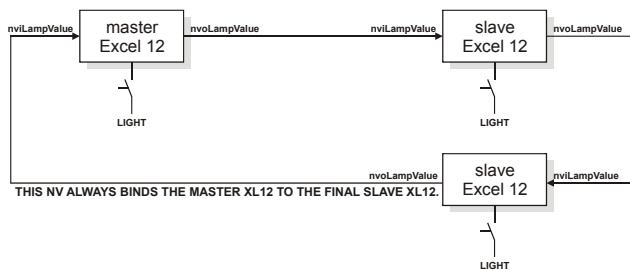


Fig. 7. All lights switched on via any pushbutton

NOTE: This binding shall not be used for applications involving dimming or constant light control. Binding via LONWORKS results in a short delay between the switching of the different lamps. Pressing the pushbutton repeatedly and rapidly may cause toggle effects.

Benefits of Integrated Room Control

The Excel 12 functionality provides you with a number of significant advantages:

Considerable Reduction in Energy Consumption:

- 25...75% savings on electrical energy consumption for illumination.
- Decreased heat generated by electric lights, thus reducing cooling energy requirements.

Increased Convenience:

- Occupancy sensor switches the light ON/OFF automatically.
- Constant light control always provides the correct lighting.
- Optional air-quality control in the occupancy mode.
- Wireless control via ZAPP (see ZAPP System Engineering, EN0B-0286GE51).

Increased Flexibility:

- Flexible room usage if a LONWORKS® wall module or ZAPP (wireless remote control) is used.

Reduced Engineering Effort / Expenses:

- Just one LONWORKS® node (instead of two) is required to cover HVAC and Light.
 - + reduced engineering and installation effort (e.g. wiring, binding, commissioning, etc.)
 - + reduced integration effort
 - + lower cost due to reduced number of LNS™ credits
 - + lower hardware total loop costs

INTEROPERABILITY

The Excel 12 has been certified as per LONMARK® Application Layer Guidelines V 3.3. and is thus interoperable with all other devices in open LONWORKS® networks (including third-party devices).

Device Configuration

The controller is configured using Honeywell's LNS™ plug-in. The plug-in can be started from CARE 4.0 or any LNS™ tool (e.g. LonMaker for Windows™).

LONMARK® Objects Network Variables

The Excel 12 supports the following LONMARK® objects:

- one node object (see Fig. 11)
- one space comfort controller object (#8501 SCC – Fan Coil) (see Fig. 12)
- three lamp actuator objects (#3040) (see Fig. 8)
- one occupancy sensor object (#1060) (see Fig. 9)
- two open loop actuator objects (#3) (see Fig. 10)

See also Table 5 through Table 8 on page 9.

Lamp Actuator Object

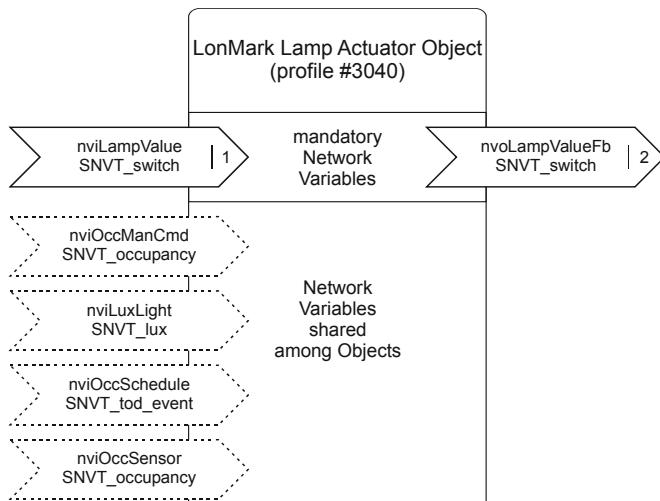


Fig. 8. Lamp Actuator Object

Occupancy Sensor Object

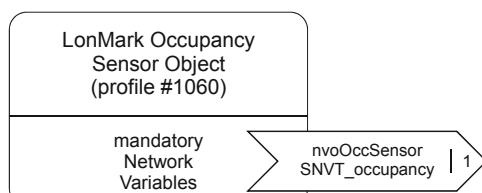


Fig. 9. Occupancy Sensor Object

Open Loop Actuator Object

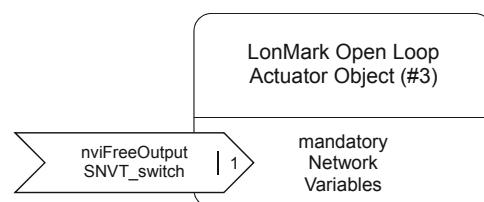


Fig. 10. Open Loop Actuator Object

Node Object

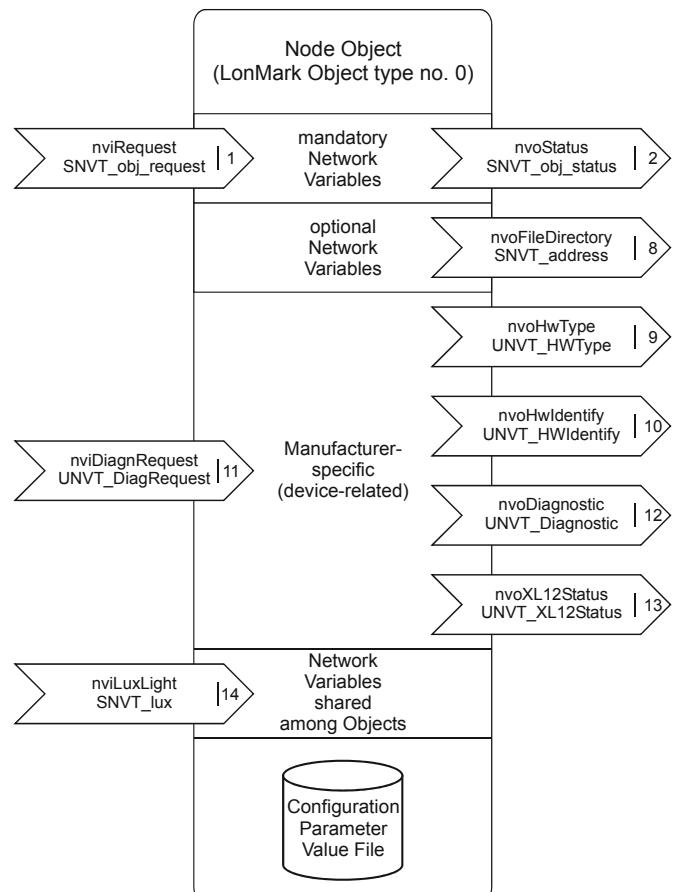


Fig. 11. Node Object

Space Comfort Controller Object

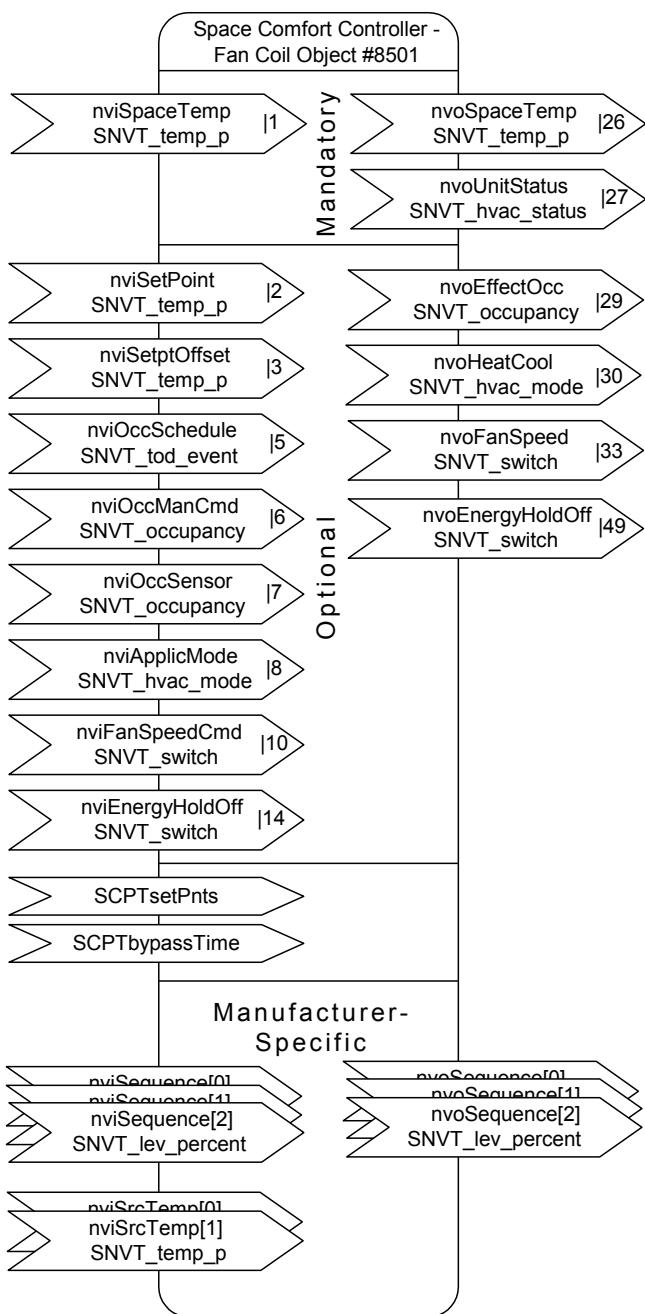


Fig. 12. FCU Controller Object

LONWORKS® Network Interface

The Excel 12 communicates within the LONWORKS® network at a rate of 78 kbs via an FTT-10A Free Topology Transceiver, which provides transformer isolation; the bus wiring is thus insensitive to polarity.

Devices so equipped can be wired in daisy chain, star, loop, or any combination thereof as long as the max. wire length requirements are met. The recommended configuration is a daisy chain with two termination modules. This layout allows for max. bus length and has the highest communication reliability, particularly when adding on to an existing bus. Refer also to <http://www.echelon.com>

Configuration and Binding

Configuration is performed using Honeywell's LNS™ plug-in, which can be started from CARE 4.0 or any LNS™ tool (e.g. LonMaker for Windows™). Likewise, binding is performed using CARE 4.0 or any LNS™ tool.

LONWORKS® Service Button and LED

All models feature a LONWORKS® service button (accessible from the outside on top of the module).

The service pin message is broadcast:

- whenever the LONWORKS® service button is pressed;
- after each reset due to power-up, software reset;
- if a hardwired pushbutton for lighting is pushed for more than 10 seconds.

See also Excel 12 Installation Instructions (EN1B-0201GE51) for more-detailed information.

All models feature a LONWORKS® service LED for commissioning and troubleshooting. The service LED displays numerous different behaviors indicating various module states for use in troubleshooting (see also Excel 12 Installation Instructions).

Models

Table 3. Overview of Excel 12 models

	short housing	long housing	24 Vac	230 Vac	binary input 1	binary input 2	binary input 3	binary input 4	relay 1 (N-O)	relay 2 (N-O)	relay 3 (N-O)	relay 4 (C-O)	relay 5 (C-O)	triac 1	triac 2	triac 3	triac 4	triac 5	triac 6	wall module LED output	A11 (NTC20k + V)	A12 (NTC20k)	A13 (fan speed / bypass)	A14 (setpoint)	A15 (NTC20k + V)	A16 (NTC20k)	A17 (NTC20k + V)	AO1 (0...10 Vdc)	AO2 (0...10 Vdc)
W7704A1004*¹	X		X	X	X	X	X	X	X	X	X	X	X							X	X	X	X	X	X	X	X		
W7704B1002*¹	X		X	X	X	X	X	X	X	X	X	X	X							X	X	X	X	X	X	X	X		
W7704C1000*¹	X	X	X	X	X	X	X							X	X	X	X	X	X	X	X	X	X	X	X	X	X		
W7704D1008	X	X		X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X			
W7704D1016		X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X			
W7704F1003*^{1*2}	X	X	X	X	X	X	X	X	X	X	X	X													X	X	X		

*¹ These hardware versions have been discontinued.

*² The hardware variant W7704F1003 is cost-optimized for light control and does not support hardwired wall modules.

Long and Short Housings

Models powered with line power (W7704A, B, and D1016) are equipped with a built-in transformer and feature a long housing (W X L X H = 180 X 76 X 110 mm).

Models powered with 24 Vac (W7704C, and D1008) require an external 24 Vac power supply and feature a short housing (W X L X H = 126 X 76 X 110 mm).

Binary Inputs

The Excel 12 is equipped with four dry-contact binary inputs. The binary inputs are fast (the signal must be stable for at least 25 ms). These inputs are often used for light pushbuttons.

Binary Outputs

The triac outputs or relay outputs can be configured for different functions.

Relay Outputs

The Excel 12 is equipped with up to two change-over (C-O) relays and up to three normally-open (N-O) relays.

Hardware Limits

- In order to ensure a reliable contact, a min. current of 50 mA is required.
- The normally-open contacts are designed for a max. continuous current of 16 A. The normally-closed contacts are designed for a max. continuous current of 1 A.
- In order to reduce the build-up of heat in the housing, the max. combined allowable current flowing through all relays simultaneously is 24 A (continuous).
- The max. peak in-rush current (20 ms) at the normally-open contact is 80 A.

Triac Outputs

The Excel 12 is equipped with up to six triac outputs.

Hardware Limits for Excel 12 with Line Power Supply

- Low signal: 0 V; high signal: 24 Vac
- Max. 250 mA** continuous current in sum for all triac outputs together
- 550 mA for max. 10 sec.
- $\cos \phi > 0.5$

Hardware Limits for Excel 12 with 24 Vac Power Supply

- Low signal: 0 V; high signal: 24 Vac
- Max. 500 mA** continuous current in sum for all triac outputs together
- 800 mA for max. 10 sec.
- $\cos \phi > 0.5$

NOTE: For controlling thermal actuators, we recommend using the 24 Vac models, which provide more current.

Analog Outputs

The Excel 12 is equipped with up to two 0...11 Vdc analog outputs each of which can drive a max. of ± 1.1 mA.


Analog Inputs

The Excel 12 is equipped with up to 7 analog inputs, all of which can be configured as slow binary inputs (in which case the signal must be stable for at least 1.25 sec) for the detection of a slow signals (e.g. from a window contact).

Table 4. Analog input usage (with wall modules)

analog input	voltage	NTC	wall module
AI1	X	X	e.g. CO ₂ or humidity
AI2		X	room temperature ¹
AI3			fan speed or bypass ²
AI4			setpoint ³
AI5	X	X	e.g. CO ₂ or humidity
AI6		X	
AI7	X	X	e.g. CO ₂ or humidity

¹ For all NTC inputs, temperatures of $\leq -50\ldots-45^{\circ}\text{C}$ are interpreted as being due to a sensor break, and temperatures of $\geq +145\ldots+155^{\circ}\text{C}$ are interpreted as being due to a sensor short-circuit.
² A contact open for ≥ 10 seconds is interpreted as a sensor failure.
³ A resistance of $> 15\text{k }\Omega$ is interpreted as being due to a sensor break, a resistance of $< 100\ \Omega$ is interpreted as being due to a sensor short-circuit.

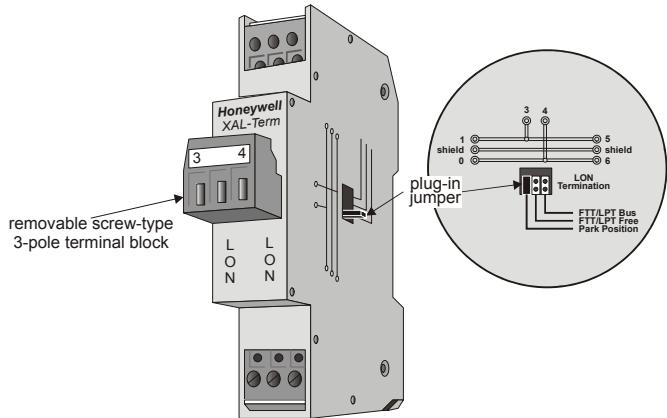**Fig. 13. Lonworks® connection and termination module**

Accessories, Standards, Ratings, and Literature

Accessories

Swivel Label Holders

For short or long housings (required for modules equipped with manual override switches).

- 24 Vac models (short), order no.: **XAL_LAB_S**
- line power supply models (long), order no.: **XAL_LAB_L**

Terminal Protection Covers

For short or long housings (required for wall/ceiling mounting).

- 24 Vac models (short), order no.: **XAL_COV_S**
- line power supply models (long), order no.: **XAL_COV_L**

LonWORKS® Termination

One or two LONWORKS® terminations are required, depending on the given LonWorks bus layout.

Two different LONWORKS® terminations are available:

- LONWORKS® termination module,
order no.: **209541B**
- LONWORKS® connection / termination module (can be mounted on DIN rails and in fuse boxes),
order no.: **XAL-Term**

Approvals and Standards

- CE and EN 50081-1
- LONMARK® Application Layer Guidelines Version 3.3

Housings

- IP20 or IP30 (with optional terminal covers)

Environmental Ratings

- Operating temperature: 32...122 °F (0...50 °C)
- Shipping/storage temperature: -22...158 °F (-30...70 °C)
- Relative humidity (operation and storage): 5...90%, non-condensing

Applicable Literature

- Excel 12 Installation Instructions (EN1B-0201GE51)
- Excel 50/500 LonWORKS® Mechanisms (EN0B-0270GE51)
- Excel 10 FTT/LPT 209541B Termination Module Installation Instructions (95-7554)
- ZAPP System Engineering (EN0B-0286GE51)
- XL12 / XL Smart I/O Plug-in Installation Guide (EN0B-0294 GE51)
- Honeywell's XL12 / Excel Smart I/O plug-in help

NETWORK INTERFACE

The following tables list the NV's associated with the various LONMARK® objects serving as network interfaces to the Excel 12 FCU + Light application.

Table 5. NV's associated with Space Comfort Controller FCU Object (profile # 8051)

name	type	heartbeat
nviSpaceTemp	SNVT_temp_p	yes
nviSetPoint	SNVT_temp_p	no
nviSetptOffset	SNVT_temp_p	yes
nviOccSchedule	SNVT_tod_event	yes
nviOccManCmd	SNVT_occupancy	no
nviOccSensor	SNVT_occupancy	yes
nviApplicMode	SNVT_hvac_mode	yes
nviFanSpeedCmd	SNVT_switch	no
nviEnergyHoldOff	SNVT_switch	yes
nviEmergOverride	SNVT_hvac_emerg	no
nviSrcTemp[2]	SNVT_temp_p	yes
nviSequence[3]	SNVT_lev_percent	yes
nvoSequence[3]	SNVT_lev_percent	yes
nvoSpaceTemp	SNVT_temp_p	yes
nvoUnitStatus	SNVT_hvac_status	yes
nvoEffectOcc	SNVT_occupancy	no
nvoHeatCool	SNVT_hvac_mode	yes
nvoFanSpeed	SNVT_switch	yes
nvoEnergyHoldOff	SNVT_switch	yes

Table 6. NV's associated with Occupancy Sensor Object (profile #1060)

name	type	heartbeat
nvoOccSensor	SNVT_occupancy	yes

Table 7. NV's associated with Lamp Actuator Object (profile #3040)

name	type	heartbeat
nviLampValue[3]	SNVT_switch	no
nvoLampValueFb[3]	SNVT_switch	no

Table 8. NV's associated with the Node Object (LONMARK® object #0)


name	type	heartbeat
nviRequest	SNVT_obj_request	no
nvoStatus	SNVT_obj_status	yes
nvoFileDirectory	SNVT_address	no
nviDiagnRequest	UNVT_DiagRequest	no
nvoDiagnostic	UNVT_Diagnostic	no
nvoXL12Status	UNVT_XL12Status	no
nviLuxLight	SNVT_lux	no
nvoHwType	UNVT_HwType	n/a
nvoHwIdentify	UNVT_HWIdentify	n/a

Table 9. NV's associated with Open Loop Actuator Object (LONMARK® object #3)

name	type	heartbeat
nviFreeOutput[2]	SNVT_switch	no

Note: Device Resource Files are included in the plug-in package and facilitate the handling of UNVTs

DIMENSIONS

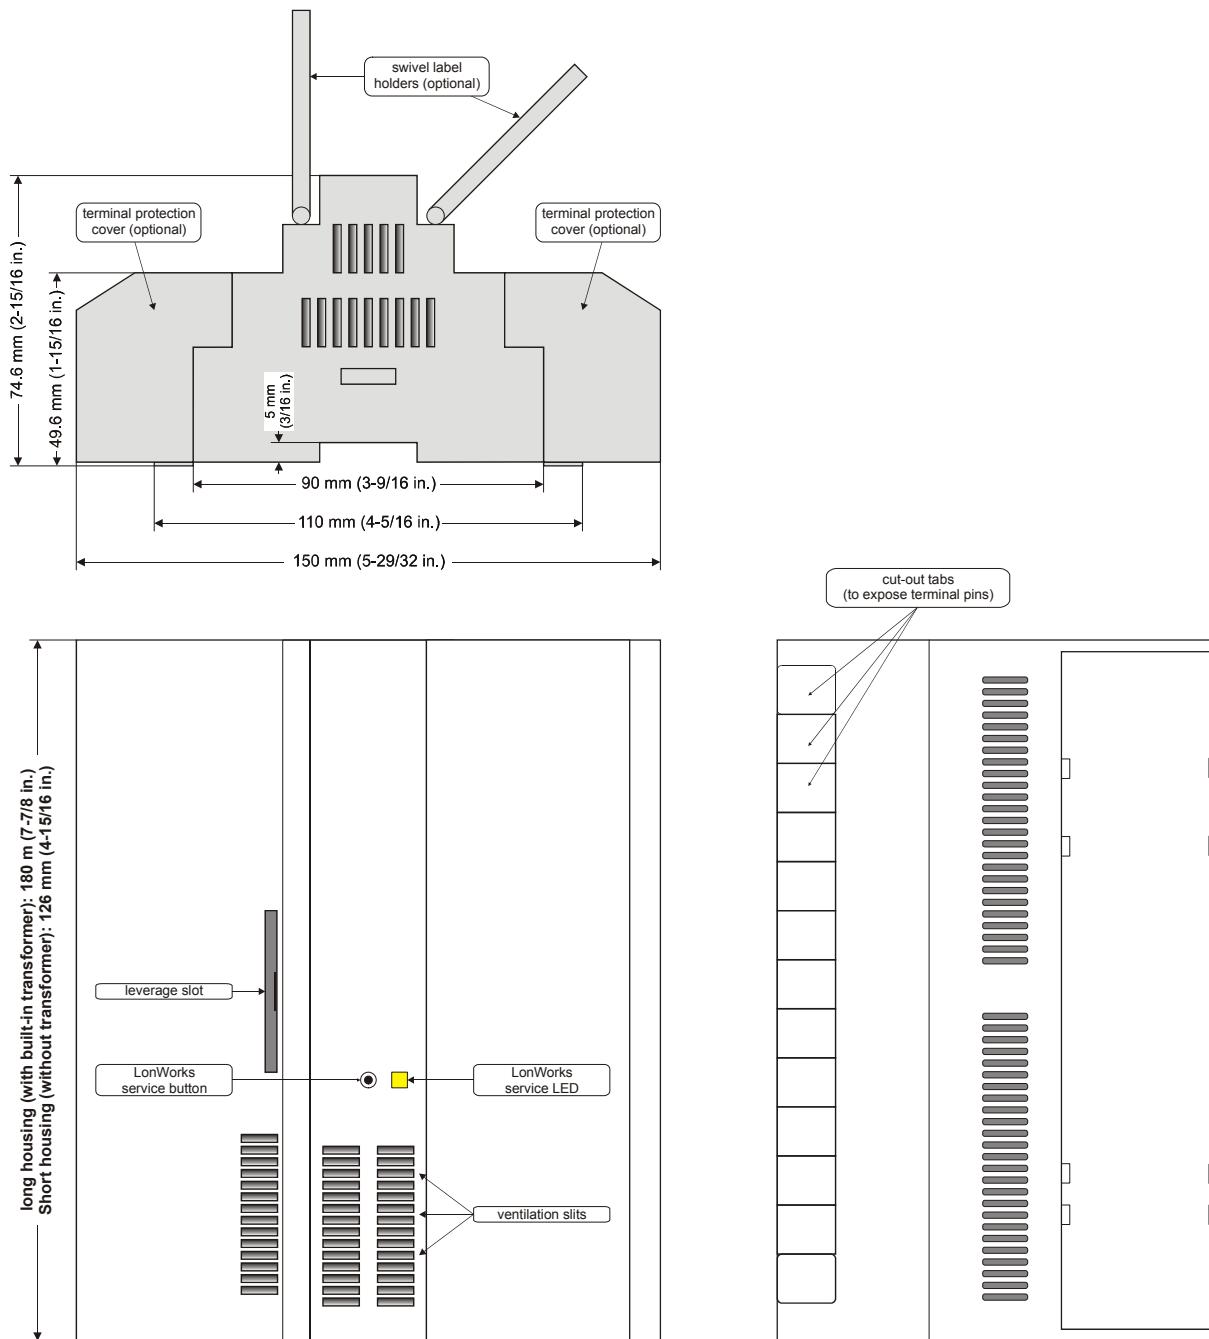

Honeywell

Manufactured for and on behalf of the Environmental and Combustion Controls Division of Honeywell Technologies Sàrl, Ecublens, Route du Bois 37, Switzerland by its Authorized Representative:

Automation and Control Solutions

Honeywell GmbH
Böblinger Straße 17
D-71101 Schönaich
Phone: (49) 7031 63701
Fax: (49) 7031 637493
<http://ecc.emea.honeywell.com>

Subject to change without notice. Printed in Germany

EN0B-0470GE51 R1107