

Open-close ball valves, 3-way,
with external thread

- for open and closed cold and warm water systems
- For switching functions on the water side and 2-point controls in air-handling and heating systems
- air bubble-tight (control path A – AB)



Type overview

Type	k_{vs} [m³/h]	DN [mm]	G [Inches]	p_s [kPa]
R515	8.6	15	1"	4140
R520	21	20	1 1/4"	4140
R525	26	25	1 1/2"	4140
R530	16	32	2"	4140
R532	32	32	2"	2760
R540	32	40	2 1/4"	2760
R550	49	50	2 3/4"	2760

Technical data

Functional data	Flow media	Cold and hot water, water with max. 50% volume of glycol
	Temperature of medium	+5 °C ... +110 °C ¹⁾ (lower or higher temperatures on request)
	Rated pressure p_s	see «Type overview»
	Flow rate	Bypass B – AB: approx. 50% of k_{vs} value
	Leakage rate	Control path A – AB: Air bubble-tight (BO 1, DIN3230 T3) Bypass B – AB: 1% of k_{vs} value
	Pipe connector	External thread to ISO 228/1
	Differential pressure Δp_{max}	1000 kPa (200 kPa for low-noise operation)
	Closing pressure Δp_s	1400 kPa
	Angle of rotation	90° ∇ (Operating range 15 ... 90° ∇)
	Installation position	Upright to horizontal (in relation to the stem)
	Maintenance	Maintenance-free
Materials	Fitting	Forged, nickel-plated brass body
	Valve cone and stem	Stainless steel
	Stem seal	O-Ring, EPDM
	Ball seat	PTFE, O-Ring Viton
Dimensions / Weights	see «Dimensions and weights», page 3	
Motorizing	see the complete overview of water solutions	

¹⁾ The allowed media temperature can be limited, depending on the type of actuator. The correct values can be found in the corresponding actuator data sheets.

Safety notes




- The valve has been designed for use in stationary heating, ventilation and air conditioning systems and is not allowed to be used outside the specified field of application, especially in aircraft or in any other airborne means of transport.
- It may only be installed by suitably trained personnel.
All applicable legal or institutional installation regulations must be complied with.
- The valve does not contain any parts that can be replaced or repaired by the user.
- The valve is not allowed to be disposed of as household refuse. All locally valid regulations and requirements must be observed.
- The recognized rules should be applied when determining the flow characteristic of final controlling elements.

Product features

Mode of operation The open-close ball valve is operated by a rotary actuator. The rotary actuator is controlled by an open-close signal. Open the ball valve counterclockwise and close it clockwise.

Installation notes

Recommended mounting positions The valve may be mounted either **vertically** or **horizontally**. It is not permissible, mounting the valve with the stem pointing downwards.

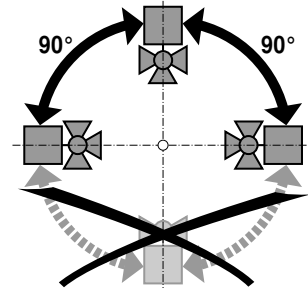


Water quality requirements

- The water quality requirements specified in VDI 2035 must be adhered to.
- Ball valves are relatively sensitive control devices. In order to ensure a long service life, it is advisable to fit **strainers**.

Maintenance

- The ball valves and rotary actuators are maintenance-free.
- Before any kind of service work is carried out on actuator sets of this type, it is essential to isolate the rotary actuator from the power supply (by unplugging the power lead). Any pumps in the part of the piping system concerned must also be switched off and the appropriate isolating fittings closed (allow everything to cool down first if necessary and reduce the pressure in the system to atmospheric).
- The system must not be returned to service until the ball valve and the rotary actuator have been properly reassembled in accordance with the instructions and the pipework has been refilled in the proper manner.

Direction of flow The direction of flow, specified by an arrow on the housing, is to be complied with, since otherwise the ball valve can be damaged. Please ensure that the ball is in the correct position.

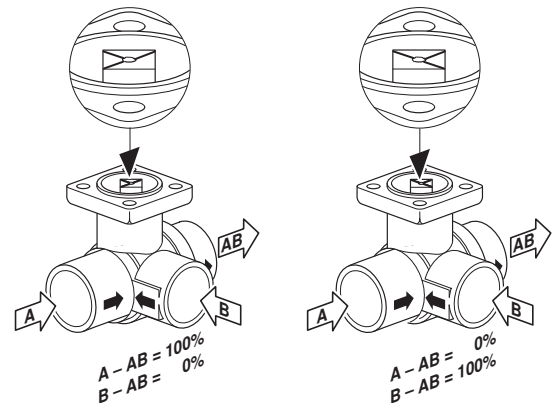


Accessories

	Description
Mechanical accessories	Stem heating ZR24-1 ¹⁾
	Pipe connector ZR45..
	¹⁾ No stem heating is available for R530, R540 and R550

Dimensions and weights

Dimensional drawings

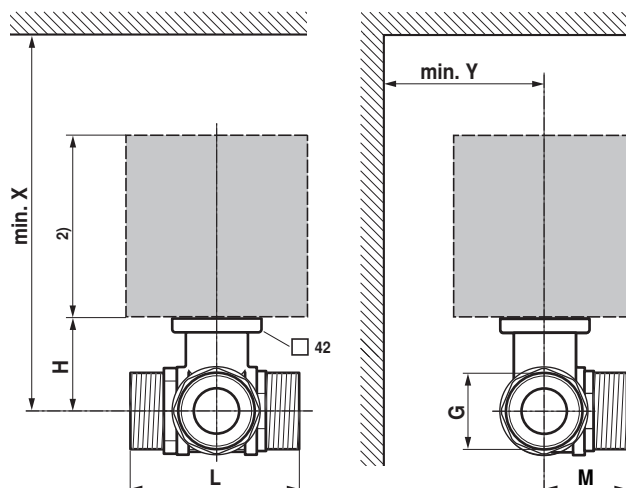

DN [mm]	L [mm]	H [mm]	M [mm]	G [Inches]	X ¹⁾ [mm]	Y ¹⁾ [mm]	Weight [kg]
15	74	44	39	1"	220	90	0.7
20	85.5	46	41.5	1 1/4"	220	90	1.0
25	84.5	46	45	1 1/2"	220	90	1.1
32 R530	97.5	46	55.5	2"	220	90	1.7
32 R532	102	50.5	55.5	2"	230	90	1.8
40	103	50.5	56	2 1/4"	230	90	2.3
50	115.5	56	68	2 3/4"	240	90	3.8


¹⁾ Minimum distance with respect to the valve centre.

²⁾ The actuator dimensions can be found on the respective actuator data sheet.


Further documentations

- Complete overview «The complete range of water solutions»
- Data sheets for actuators
- Installation instructions for ball valves and/or actuators
- Notes for project planning (hydraulic characteristic curves and circuits, installation regulations, commissioning, maintenance etc.)

R4..(K)



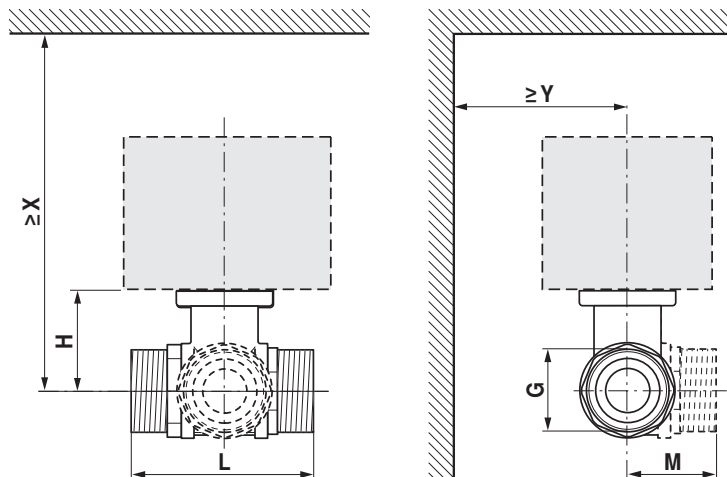






R5..(K)



70167-00001.B



t -10 ... +100°C																									
p _s 1600 kPa																									
		DN	G	mm			80°C		100°C																
							KR..		TR..		LR..A		NR..A		SR..A		TRF..		LRF..		NRF..A		SRF..A		
		mm	”	L	H	M	X	Y	X	Y	X	Y	X	Y	X	Y	X	Y	X	Y	X	Y	X	Y	X
R405K ... R409K	R505K ... R508K	10	¾”	69	31.5	34	138	75	173	75	187	75	218	80	218	80	178	60	188	90	188	90	188	90	
R409 ... R415	R509 ... R515	15	1“	74	44	37	150	75	185	75	195	75	230	80	230	80	190	60	200	90	220	90	220	90	
R417 ... R420	R517 ... R520	20	1¼”	85.5	46	42.5					200	75	235	80	235	80			205	90	225	90	225	90	
R422 ... R425	R522 ... R525	25	1½”	84.5	46	47.5					200	75	235	80	235	80			205	90	225	90	225	90	
R429 ... R430	R529 ... R530	32	2“	97.5	46	56					200	75	235	80	235	80			205	90	225	90	225	90	
R431 ... R432	R531 ... R532	32	2“	102	50.5	56							240	80	240	80					230	90	230	90	
R438 ... R440	R538 ... R540	40	2¼”	103	50.5	60.5							240	80	240	80					230	90	230	90	
R448 ... R450	R548 ... R550	50	2¾”	115.5	56	71.5									245	80							235	90	

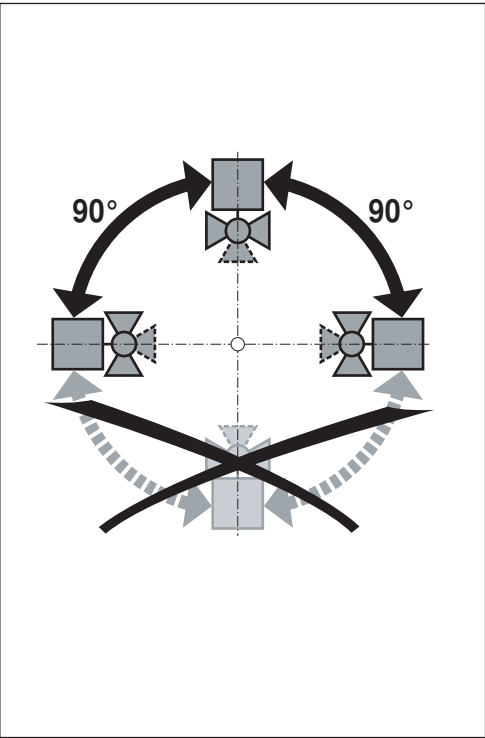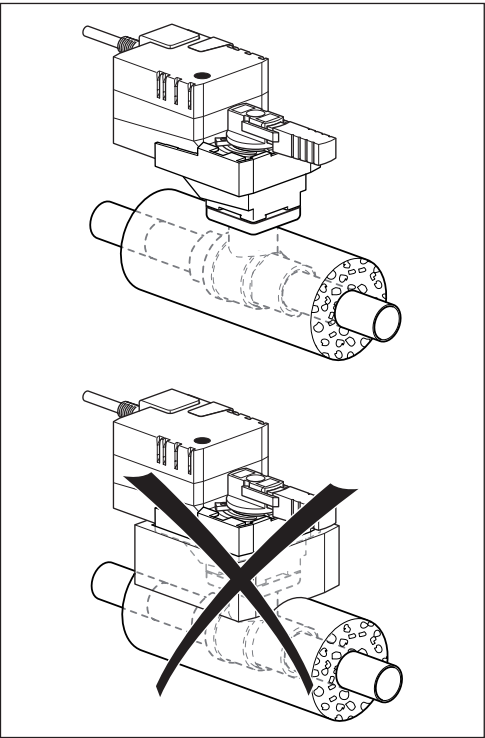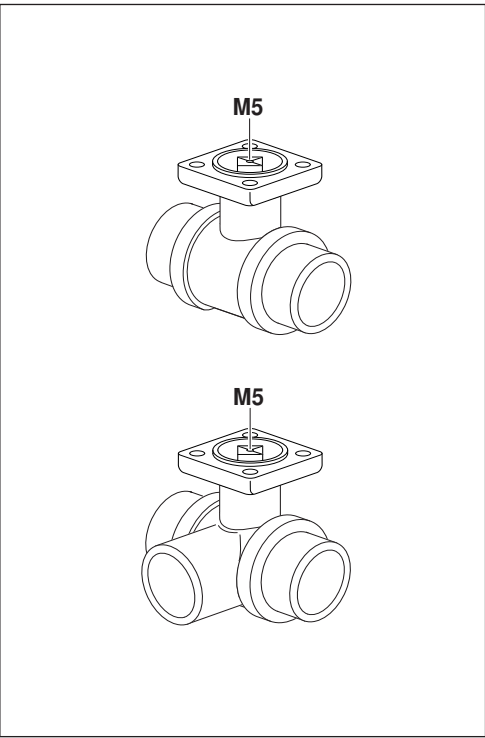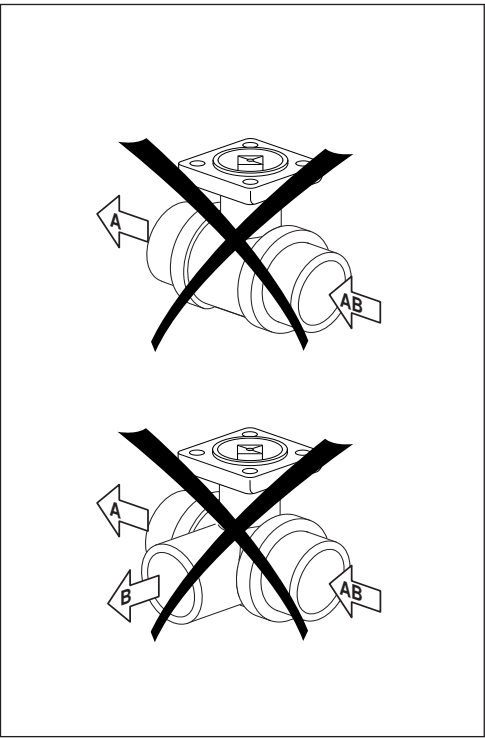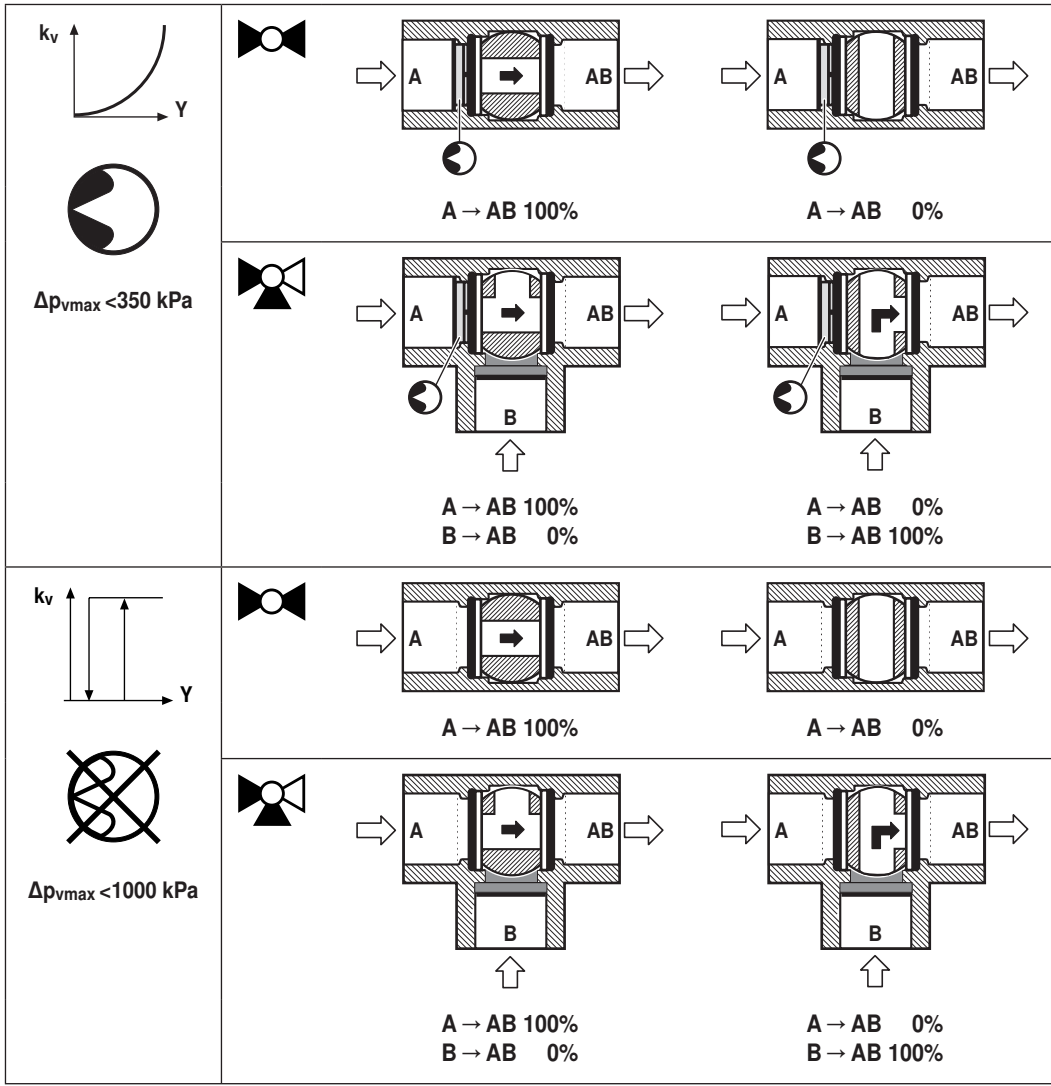

	<p>A → AB 100%</p>	<p>A → AB 0%</p>
	<p>B → AB 0%</p>	<p>B → AB 100%</p>